


**NOZZLE SCHEDULE (2,000 GAL.)**

SERVICE	QTY.	NOZZLE	SIZE	CLASS	PIPE SCH.	WALL THK. (in)	EXT. PROJ	INT. PROJ	PIPE LGTH	REINFORCING PLATE DATA	FILLET WELD SIZE	WELDING DETAIL				
							J	Hs	T.O.E.	T	Do	Dp	A	B	C	
PRODUCT FILL	1	A	4"		40	0.237	4"	4 3/16"	3/16"	3/16"			3/16"	3/16"	3/16"	
VAPOR RECOVERY	1	B	4"		40	0.237	4"	4 3/16"	3/16"	3/16"			3/16"	3/16"	3/16"	
GAUGE	1	C	2"		40	0.154	4"	4 3/16"	3/16"	3/16"			3/16"	3/16"	3/16"	
DISPENSING PORT	2	D	2"		40	0.154	4"	4 3/16"	3/16"	3/16"			3/16"	3/16"	3/16"	
PRIMARY EMER. VENT	1	E	6"		40	0.280	4"	4 3/16"	3/16"	3/16"			3/16"	3/16"	3/16"	
ELECTRONIC MONITOR	1	F	4"		40	0.237	4"	4 3/16"	3/16"	3/16"			3/16"	3/16"	3/16"	
SECONDARY EMER. VENT	1	G	6"		40	0.280	4"	4 3/16"	3/16"	3/16"			3/16"	3/16"	3/16"	
NORMAL VENT	1	H	2"		40	0.154	4"	4 3/16"	3/16"	3/16"			3/16"	3/16"	3/16"	
SECONDARY MONITOR	1	I	2"		40	0.154	4"	4 3/16"	3/16"	3/16"			3/16"	3/16"	3/16"	
CONCRETE PORT	2	J	3"		40											
SPARE	1	K	4"		40	0.237		4 3/16"	3/16"	3/16"			3/16"	3/16"	3/16"	

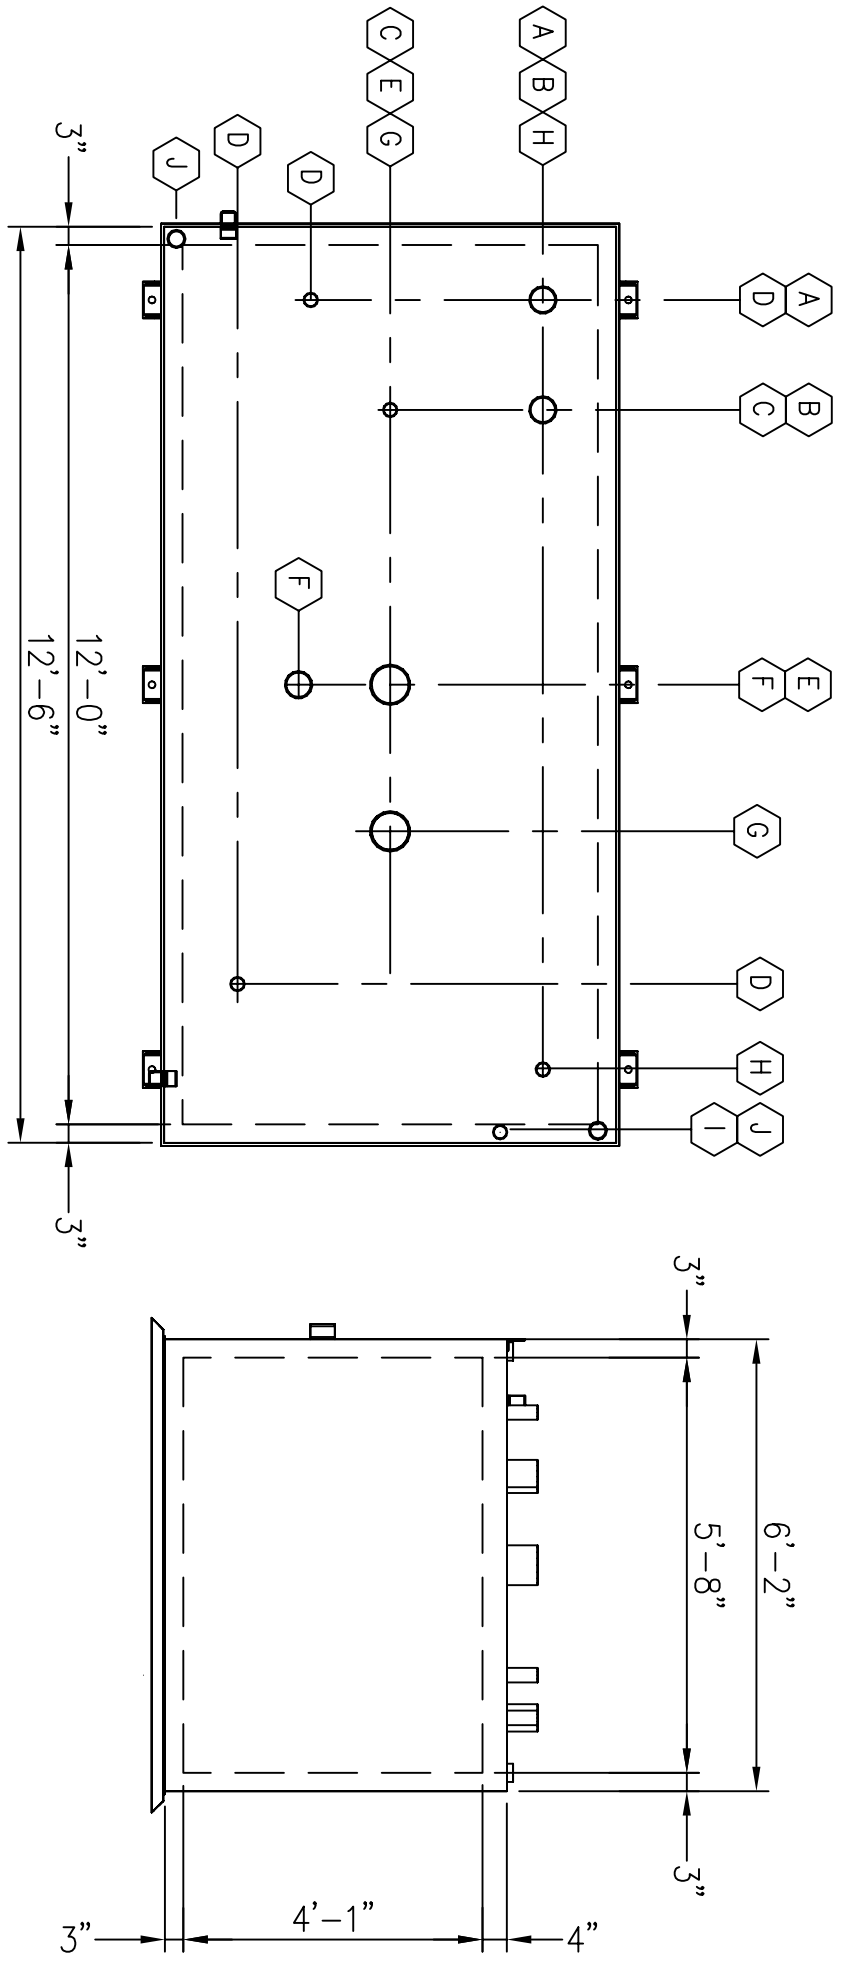

**PLAN VIEW**

**SIDE**

**REFERENCE DRAWINGS**

**REVISIONS**



VT-2000

FIREGUARD TANK (2,000 GAL)

ISSUE FOR REVIEW

TVB LD

PHONE: (661) 327-1205

BAKERSFIELD, CALIFORNIA

DWG. SCALE: \_\_\_\_\_ DATE: 1/31/07

DR. T. BLACK CH. L. DAVIS DR. APP. \_\_\_\_\_

JOB NO.

DRAWING NO.

SHT. 1 OF 1

REV. A

TITLE:	
DWG No.:	A
TITLE:	1/31/07
DWG No.:	
TITLE:	
DWG No.:	

TITLE:	
DWG No.:	
TITLE:	
DWG No.:	
TITLE:	
DWG No.:	

TITLE:	
DWG No.:	
TITLE:	
DWG No.:	
TITLE:	
DWG No.:	