NOZZLE SCHEDULE (2,000 Gal. SPLIT)

SERVICE	QTY.	NOZZLE	SIZE	CLASS	PIPE SCH.	WALL THK. (in)	EXT. PROJ. J	INT. PROJ. Hs	PIPE LGTH	REINFORCING PLATE DATA T	Do	Dp	FILLET WELD SIZE A	B	C	WELDING DETAIL
PRODUCT FILL	2	A	4"		40	0.237	4"	4 3/16"	T.O.E.	3/16"			3/16"	3/16"	3/16"	
VAPOR RECOVERY	2	B	4"		40	0.237	4"	4 3/16"	T.O.E.	3/16"			3/16"	3/16"	3/16"	
GAUGE	2	C	2"		40	0.154	4"	4 3/16"	T.O.E.	3/16"			3/16"	3/16"	3/16"	
DISPENSING PORT	2	D	2"		40	0.154	4"	4 3/16"	T.O.E.	3/16"			3/16"	3/16"	3/16"	
PRIMARY EMER. VENT	2	E	6"		40	0.280	4"	4 3/16"	T.O.E.	3/16"			3/16"	3/16"	3/16"	
ELECTRONIC MONITOR	2	F	4"		40	0.237	4"	4 3/16"	T.O.E.	3/16"			3/16"	3/16"	3/16"	
SECONDARY EMER. VENT	1	G	6"		40	0.280	4"	3/16"	T.O.E.	3/16"			3/16"	3/16"	3/16"	
NORMAL VENT	2	H	2"		40	0.154	4"	4 3/16"	T.O.E.	3/16"			3/16"	3/16"	3/16"	
SECONDARY MONITOR	1	I	2"		40	0.154	4"	4 3/16"	T.O.E.	3/16"			3/16"	3/16"	3/16"	
CONCRETE PORT	2	J	3"		BONNEY	FLANGE										
			4"		40	0.237	4"	4 3/16"	T.O.E.	3/16"			3/16"	3/16"	3/16"	

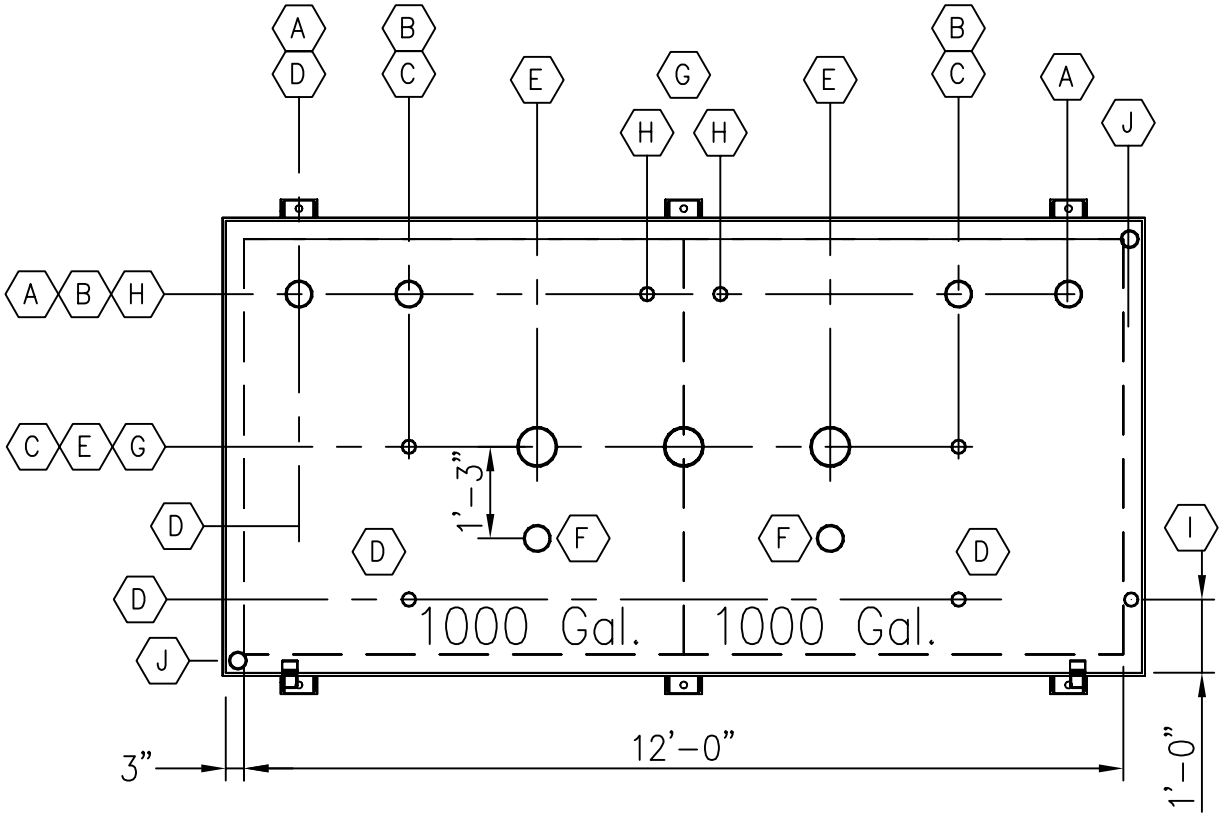

PLAN VIEW

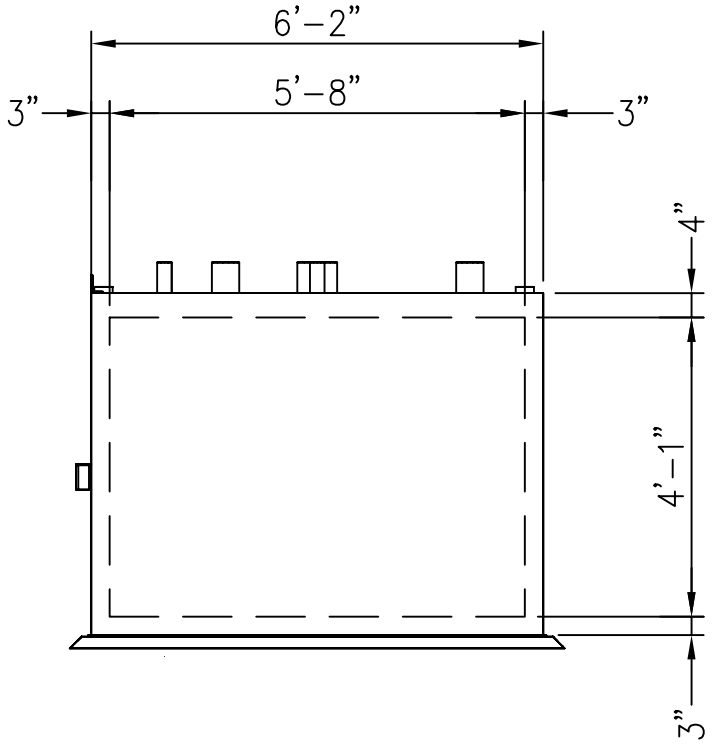

SIDE

REFERENCE DRAWINGS		REVISIONS			
TITLE:		A	ISSUE FOR REVIEW	LD	LD
DWG No:		3-20-07			
TITLE:					
DWG No:					
TITLE:					
DWG No:					

Spartan Inc.
Plant & Facilities Engineering/Design
PHONE: (661) 327-1205 BAKERSFIELD, CALIFORNIA

DWG. SCALE _____ DATE 3-20-07
DR. L.DAVIS CH. L. DAVIS DR. APP. _____

VT-2000 SPLIT

FIREGUARD (2,000 GAL) SPLIT 1000 1000

JOB NO.	DRAWING NO.	SHT.	REV.
		1 OF 1	A