


NOZZLE SCHEDULE (2,500 GAL.)

SERVICE	QTY.	NOZZLE	SIZE	CLASS	PIPE SCH.	WALL THK. (in)	EXT. PROJ	INT. PROJ	PIPE LGTH	REINFORCING PLATE DATA	FILLET WELD SIZE	WELDING DETAIL
							J	Hs		T Do Dp	A B C	
PRODUCT FILL	1	A	4"		40	0.237	4"	4 3/16"	T.O.E.	3/16"	3/16"	3/16"
VAPOR RECOVERY	1	B	4"		40	0.237	4"	4 3/16"	T.O.E.	3/16"	3/16"	3/16"
GAUGE	1	C	2"		40	0.154	4"	4 3/16"	T.O.E.	3/16"	3/16"	3/16"
DISPENSING PORT	2	D	2"		40	0.154	4"	4 3/16"	T.O.E.	3/16"	3/16"	3/16"
PRIMARY EMER. VENT	1	E	6"		40	0.280	4"	4 3/16"	T.O.E.	3/16"	3/16"	3/16"
ELECTRONIC MONITOR	1	F	4"		40	0.237	4"	4 3/16"	T.O.E.	3/16"	3/16"	3/16"
SECONDARY EMER. VENT	1	G	6"		40	0.280	4"	3/16"	T.O.E.	3/16"	3/16"	3/16"
NORMAL VENT	1	H	2"		40	0.154	4"	4 3/16"	T.O.E.	3/16"	3/16"	3/16"
SECONDARY MONITOR	1	I	2"		40	0.154	4"	4 3/16"	T.O.E.	3/16"	3/16"	3/16"
CONCRETE PORT	2	J	3"									
								BONNEY				
								FLANGE				

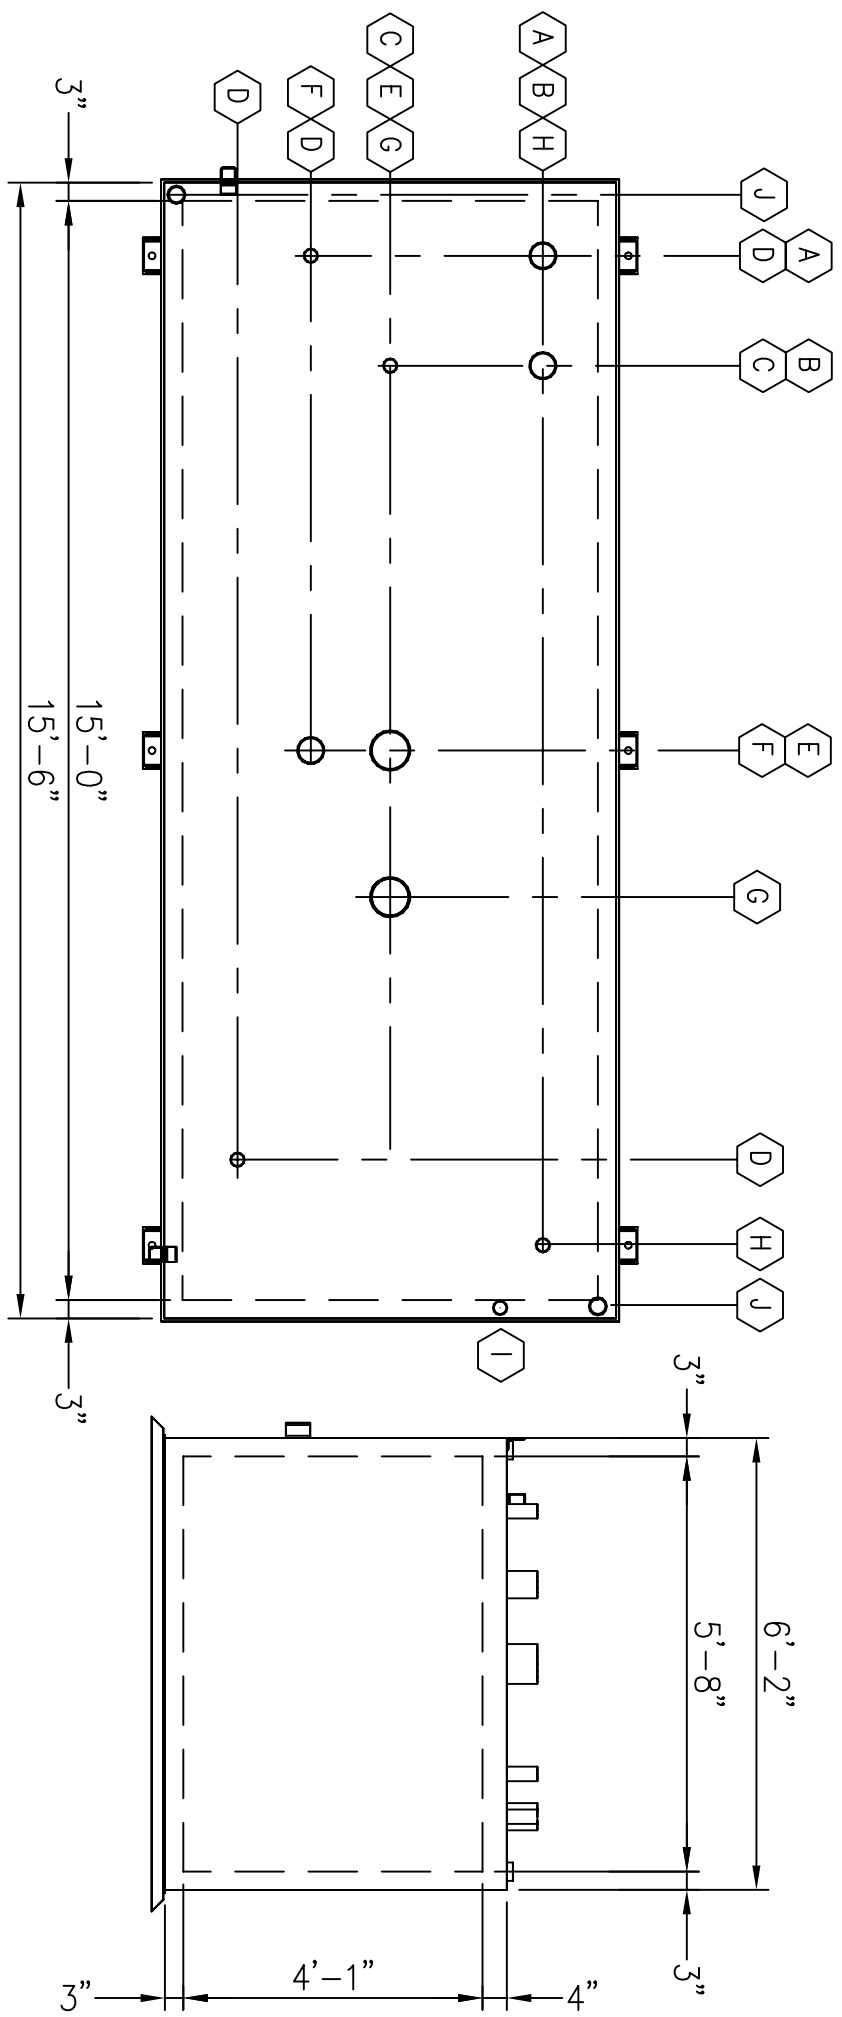

PLAN VIEW

SIDE

REFERENCE DRAWINGS

REVISIONS



VT-2500
FIREGUARD TANK (2,500 GAL)

TITLE:	ISSUE FOR REVIEW		TVB	LD
DWG No.:	A			
TITLE:	1/31/07			
DWG No.:				
TITLE:				
DWG No.:				
PHONE:	(661) 327-1205		BAKERSFIELD, CALIFORNIA	
DWG. SCALE:			DATE:	1/31/07
DR. T. BLACK	CH. L. DAVIS	DR. APP.		
JOB NO.	DRAWING NO.	SHT.	1 OF 1	
		REV.	A	