


NOZZLE SCHEDULE (6,000 GAL.)

SERVICE	QTY.	NOZZLE	SIZE	CLASS	PIPE SCH.	WALL THK (in)	EXT. PROU J	INT. PROU HS	PIPE LGTH	REINFORCING PLATE DATA	FILLET WELD SIZE	WELDING DETAIL	
										Do	A	B	C
PRODUCT FILL	1	A	4"		40	0.237	4"	4 3/16"	TO.E.	1/4"	3/16"	3/16"	3/16"
VAPOR RECOVERY	1	B	4"		40	0.237	4"	4 3/16"	TO.E.	1/4"	3/16"	3/16"	3/16"
GAUGE	1	C	2"		40	0.154	4"	4 3/16"	TO.E.	1/4"	3/16"	3/16"	3/16"
DISPENSING PORT	2	D	2"		40	0.154	4"	4 3/16"	TO.E.	1/4"	3/16"	3/16"	3/16"
PRIMARY EMER. VENT	1	E	8"		40	0.322	6"	4 3/16"	TO.E.	1/4"	3/16"	3/16"	3/16"
ELECTRONIC MONITOR	1	F	4"		40	0.237	4"	4 3/16"	TO.E.	1/4"	3/16"	3/16"	3/16"
SECONDARY EMER. VENT	1	G	8"		40	0.322	6"	3/16"	TO.E.	1/4"	3/16"	3/16"	3/16"
NORMAL VENT	1	H	2"		40	0.154	4"	4 3/16"	TO.E.	1/4"	3/16"	3/16"	3/16"
SECONDARY MONITOR	1	I	1"		40	0.154	4"	4 3/16"	TO.E.	1/4"	3/16"	3/16"	3/16"
CONCRETE PORT	2	J	3"						TO.E.	1/4"			
MANWAY	1	K	20"								3/16"	3/16"	3/16"

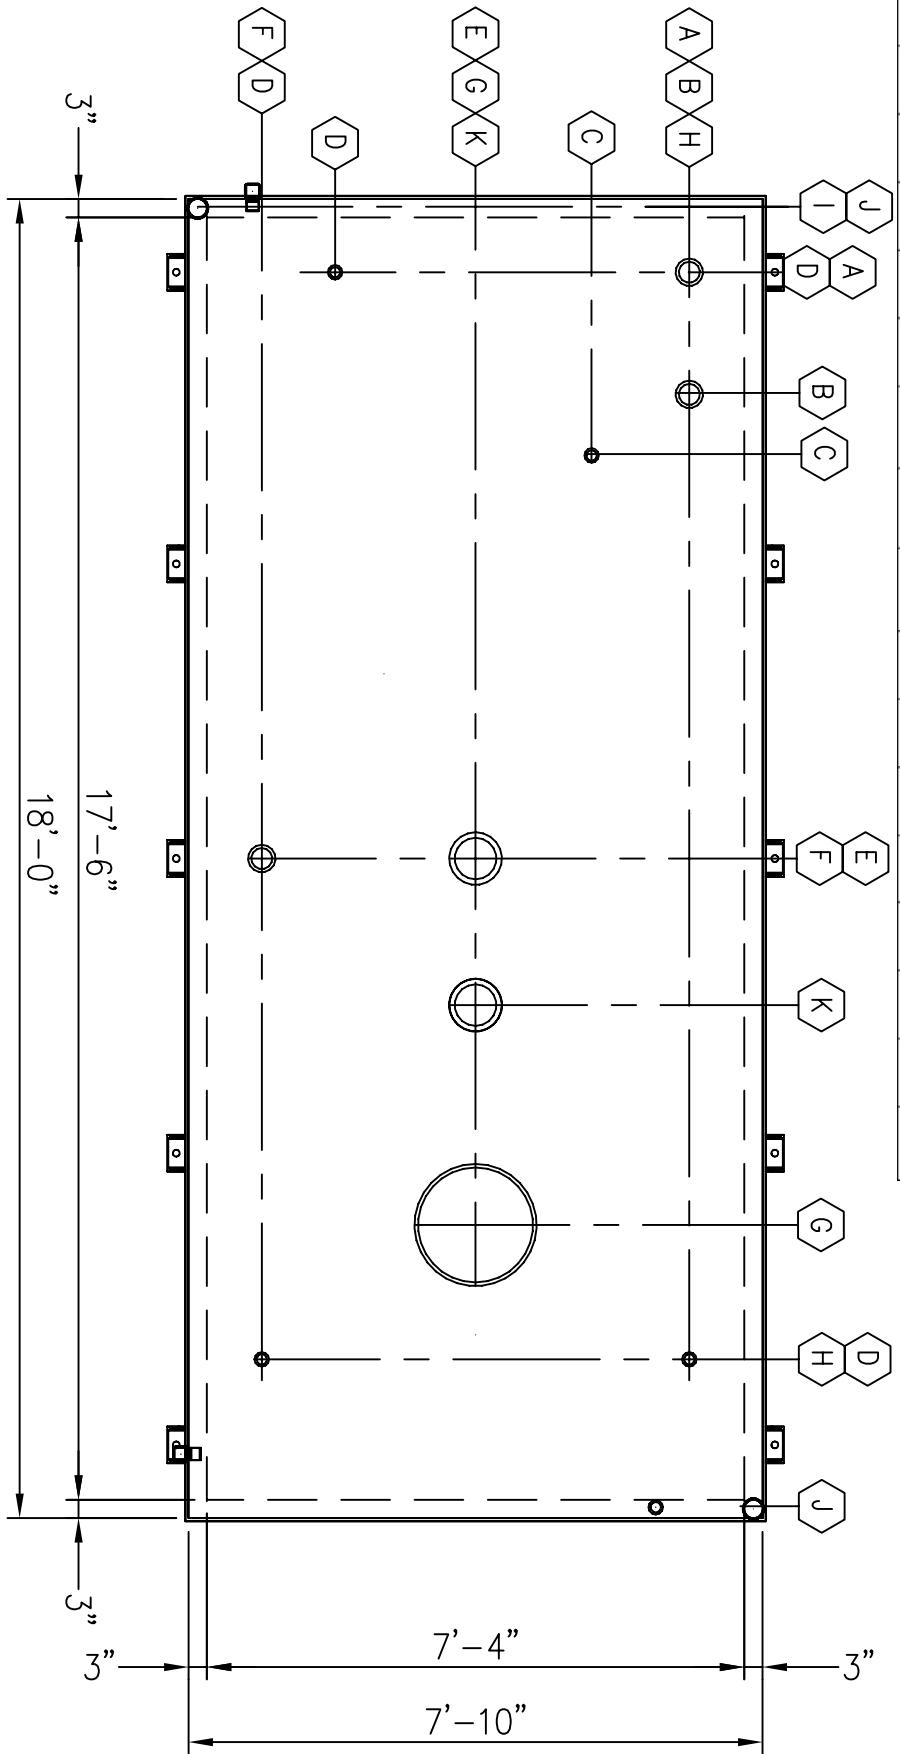

PLAN VIEW

REFERENCE DRAWINGS

TITLE:	
DWG No.:	
TITLE:	
DWG No.:	
TITLE:	
DWG No.:	

REVISIONS

ISSUE FOR REVIEW	TVB	LD
A		



PHONE: (661) 327-1205 BAKERSFIELD, CALIFORNIA

DWG. SCALE: DATE: 1/31/07
 DR. T. BLACK CH. L. DAVIS DR. APP.

VT-6000

FIREGUARD TANK (6,000 GAL)

JOB NO.	DRAWING NO.	SHT. 1 OF 1	REV. A
---------	-------------	-------------	--------