


NOZZLE SCHEDULE (10,000 GAL.)

SERVICE	QTY.	NOZZLE	SIZE	CLASS	PIPE SCH.	WALL THK. (in)	EXT. PROJ.	INT. PROJ.	PIPE LGTH	REINFORCING PLATE DATA			FILLET WELD SIZE			WELDING DETAIL
										T	Do	Dp	A	B	C	
PRODUCT FILL	1	A	4"		40	0.237	4"	3 1/4"	TO.E.	1/4"		1/4"	1/4"	1/4"		
VAPOR RECOVERY	1	B	4"		40	0.237	4"	3 1/4"	TO.E.	1/4"		1/4"	1/4"	1/4"		
GAUGE	1	C	2"		40	0.154	4"	3 1/4"	TO.E.	1/4"		1/4"	1/4"	1/4"		
DISPENSING PORT	1	D	2"		40	0.154	4"	3 1/4"	TO.E.	1/4"		1/4"	1/4"	1/4"		
SECONDARY EMER. VENT	1	E	8"		40	0.322	4"	3 1/4"	TO.E.	1/4"		1/4"	1/4"	1/4"		
ELECTRONIC MONITOR	1	F	4"		40	0.237	4"	3 1/4"	TO.E.	1/4"		1/4"	1/4"	1/4"		
PRIMARY EMER. VENT	1	G	8"	150#	40	0.322	6"	3 1/4"	FLG	1/4"		1/4"	1/4"	1/4"		
NORMAL VENT	1	H	2"		40	0.154	4"	3 1/4"	TO.E.	1/4"		1/4"	1/4"	1/4"		
SECONDARY MONITOR	1	I	2"		40	0.154	4"	3 1/4"	TO.E.	1/4"		1/4"	1/4"	1/4"		
CONCRETE PORT	4	J	3"		BONNEY	FLANGE			TO.E.	1/4"		1/4"	1/4"	1/4"		
MANWAY	1	K	20"		40	1/4"	4"	3 1/4"	TO.E.	1/4"		1/4"	1/4"	1/4"		
PRIMARY EMER. VENT	1	L	6"		40	0.280	4"	3 1/4"	TO.E.	1/4"		1/4"	1/4"	1/4"		

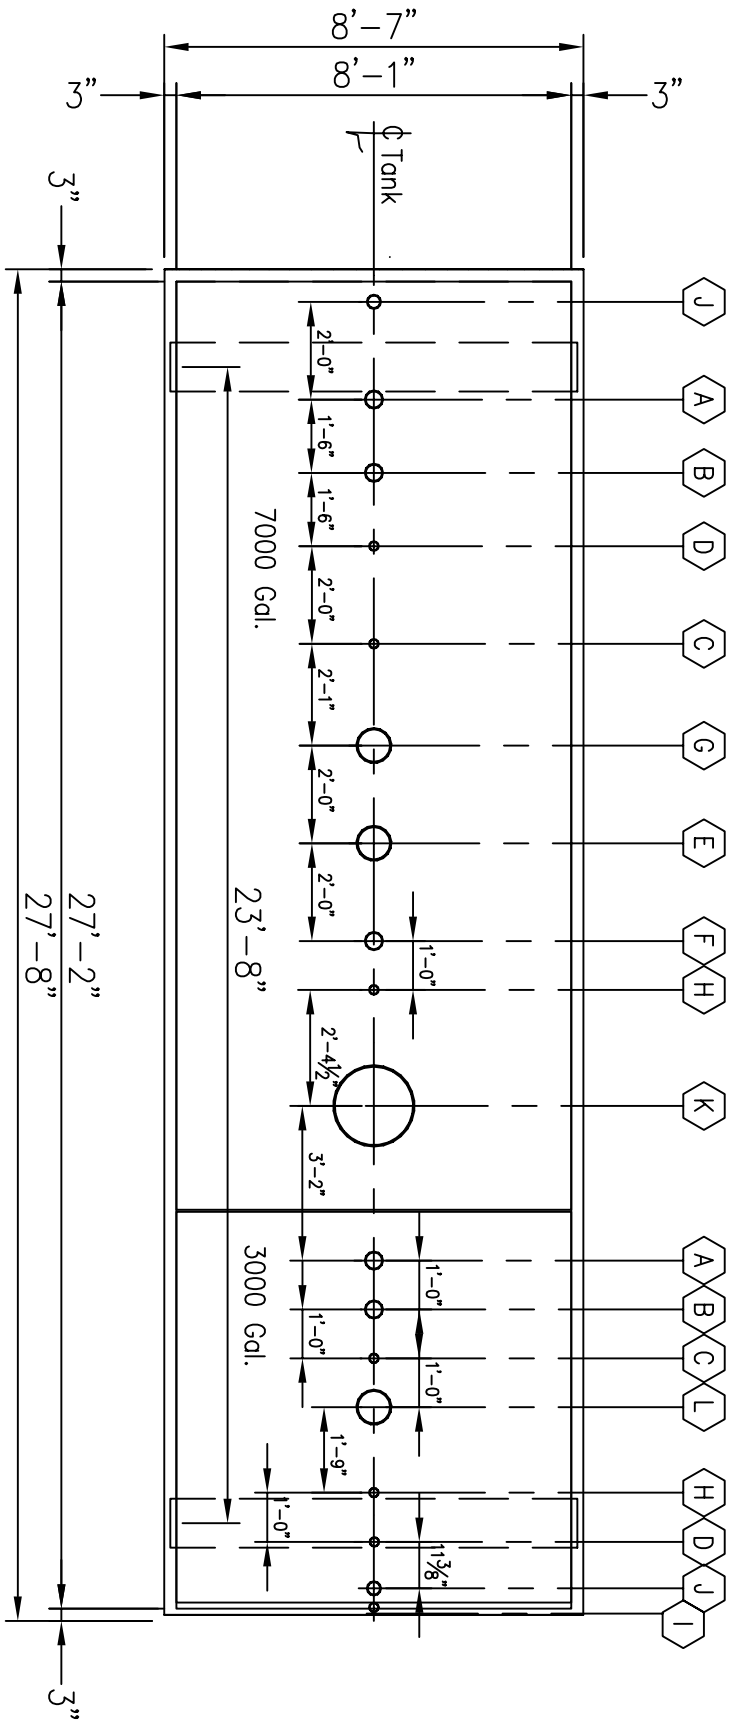

PLAN VIEW

REFERENCE DRAWINGS

REVISIONS



PHONE: (661) 327-1205 BAKERSFIELD, CALIFORNIA

DWG. SCALE _____ DATE _____

DR. _____ CH. _____ DR. APP. _____

JOB NO.

DRAWING NO.

SHT.

REV.