NOZZLE SCHEDULE (12,000 GAL.)																
SERVICE	QTY.	NOZZLE	SIZE	CLASS	PIPE SCH.	WALL THK. (in)	EXT. PROJ. J	INT. PROJ. Hs	PIPE LGTH	REINFORCING PLATE DATA			FILLET WELD SIZE			WELDING DETAIL
										T	Do	Dp	A	B	C	
PRODUCT FILL	2	A	4"		40	1/4"	4"	3 3/16"	T.O.E.	3/16"			3/16"	3/16"	3/16"	
VAPOR RECOVERY	2	B	4"		40	1/4"	4"	3 3/16"	T.O.E.	3/16"			3/16"	3/16"	3/16"	
GAUGE	2	C	2"		40	1/4"	4"	3 3/16"	T.O.E.	3/16"			3/16"	3/16"	3/16"	
DISPENSING PORT	2	D	2"		40	1/4"	4"	3 3/16"	T.O.E.	3/16"			3/16"	3/16"	3/16"	
PRIMARY EMER. VENT	2	E	8"		40	1/4"	4"	3 3/16"	T.O.E.	3/16"			3/16"	3/16"	3/16"	
ELECTRONIC MONITOR	2	F	4"		40	1/4"	4"	3 3/16"	T.O.E.	3/16"			3/16"	3/16"	3/16"	
SECONDARY EMER. VENT	1	G	8"		40	1/4"	6"	3 3/16"	T.O.E.	3/16"			3/16"	3/16"	3/16"	
NORMAL VENT	2	H	2"		40	1/4"	4"	3 3/16"	T.O.E.	3/16"			3/16"	3/16"	3/16"	
SECONDARY MONITOR	1	I	2"		40	1/4"	4"	3 3/16"	T.O.E.	3/16"			3/16"	3/16"	3/16"	
CONCRETE PORT	4	J	3"		BONNEY	FLANGE										
MANWAY	2	K	20"		40	1/4"	4"	3 3/16"	T.O.E.	3/16"			3/16"	3/16"	3/16"	

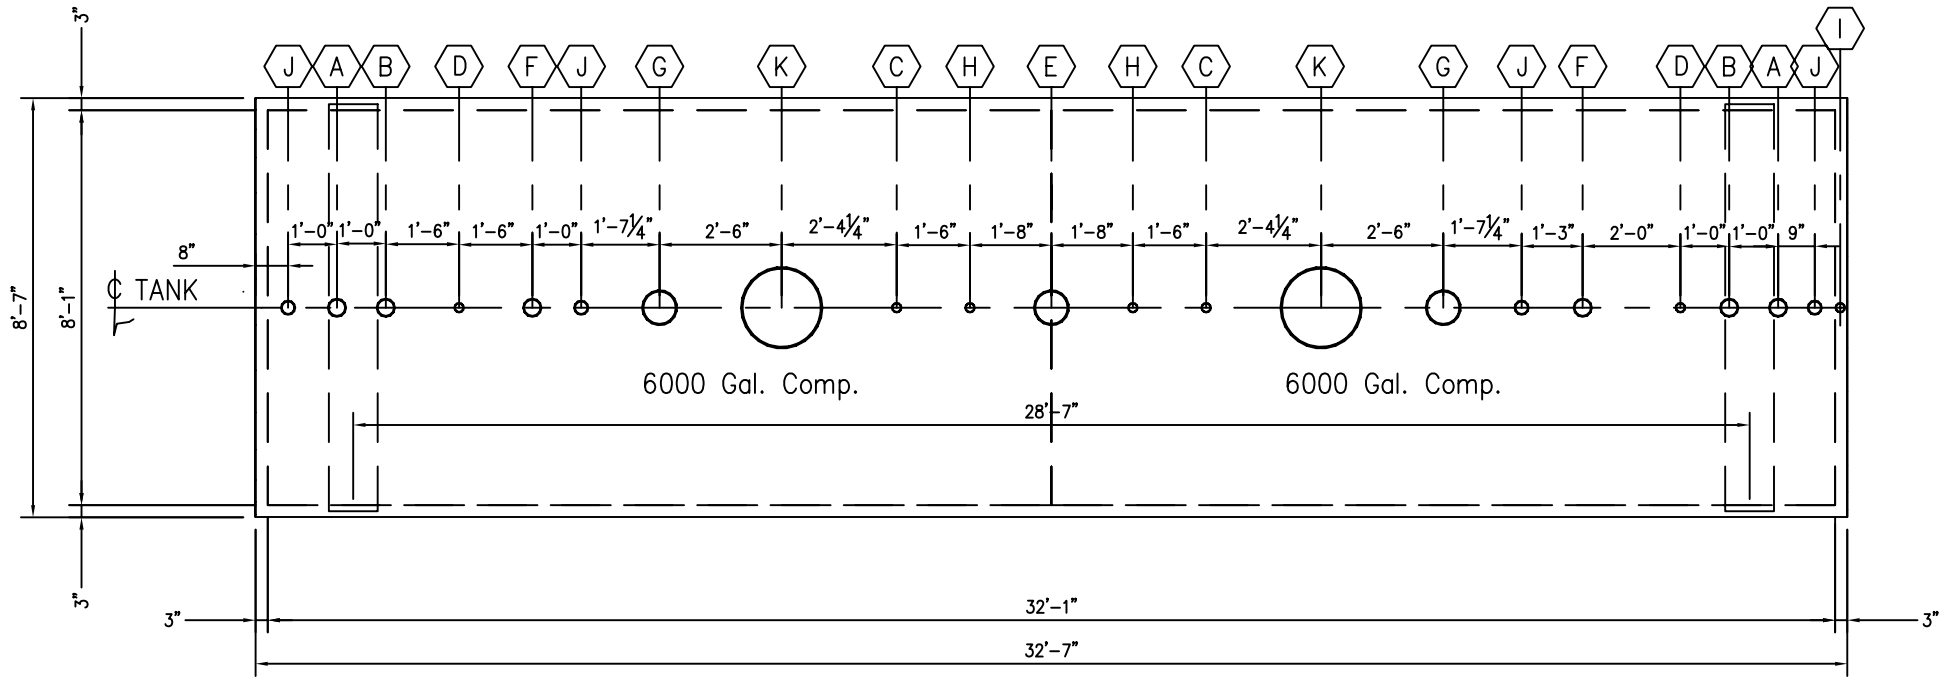

PLAN VIEW

REFERENCE DRAWINGS		REVISIONS				Spartan Inc. Plant & Facilities Engineering/Design	VT-CC-12000 SPLIT 6000 6000 FIREGUARD TANK (12,000 GAL)			
TITLE:		A	ISSUE FOR REVIEW	LD	LD	PHONE: (661) 327-1205 BAKERSFIELD, CALIFORNIA				
DWG No:		3-20-07								
TITLE:						DWG. SCALE _____ DATE 3-20-07		JOB NO.	DRAWING NO.	SHT. 1 OF 1 / REV. A
DWG No:						DR. L.DAVIS CH. L. DAVIS DR. APP. _____				
TITLE:										
DWG No:										